

**KORIDOR
UTILITI**
DARUL RIDZUAN



**TENAGA
NASIONAL**

**MSVT (DTPGS254551) MENUKAR KABEL TALIAN ATAS VOLTAN
TINGGI 11KV ABC BERSAIZ 70MMP KEPADA KABEL BAWAH TANAH
XLPE 3C 240MMP DARI SS KG. TERAS KE PE KG. TERAS, TAIPING
SEPANJANG 2100M**

PELAN IZIN LALU

**NO FAIL RUJUKAN
KUDR/TNBS/A/06/25/0619**



TAJUK PERMOHONAN
 MSVT (DTPGS254551) MENUKAR KABEL TALIAN ATAS VOLTAN TINGGI 11KV ABC BERSAIZ 70MMP KEPADA KABEL BAWAH TANAH XLPE 3C 240MMP DARI SS KG. TERAS KE PE KG. TERAS, TAIPING SEPANJANG 2100M


- PETUNJUK**
- JALAN JKR
 - JALAN PBT
 - JALAN PERSENDIRIAN
 - JAMBATAN
 - GRASS VERGE
 - - - HORIZONTAL DIRECTIONAL DRILLING
 - ⊗ TITIK MULA/AKHIR

PIHAK BERKUASA MELULUS

JABATAN KERJA RAYA LARUT MATANG & SELAMA



JENIS PELAN	PELAN IZIN LALU
PELUKIS PELAN	SYAHMIZA SUHAILA
TARIKH DIKELUARKAN	2025-06-19
MUKA SURAT	1/1
NO FAIL RUJUKAN	PINDAAN
KUDR/TNBS/A/06/25/0619	00

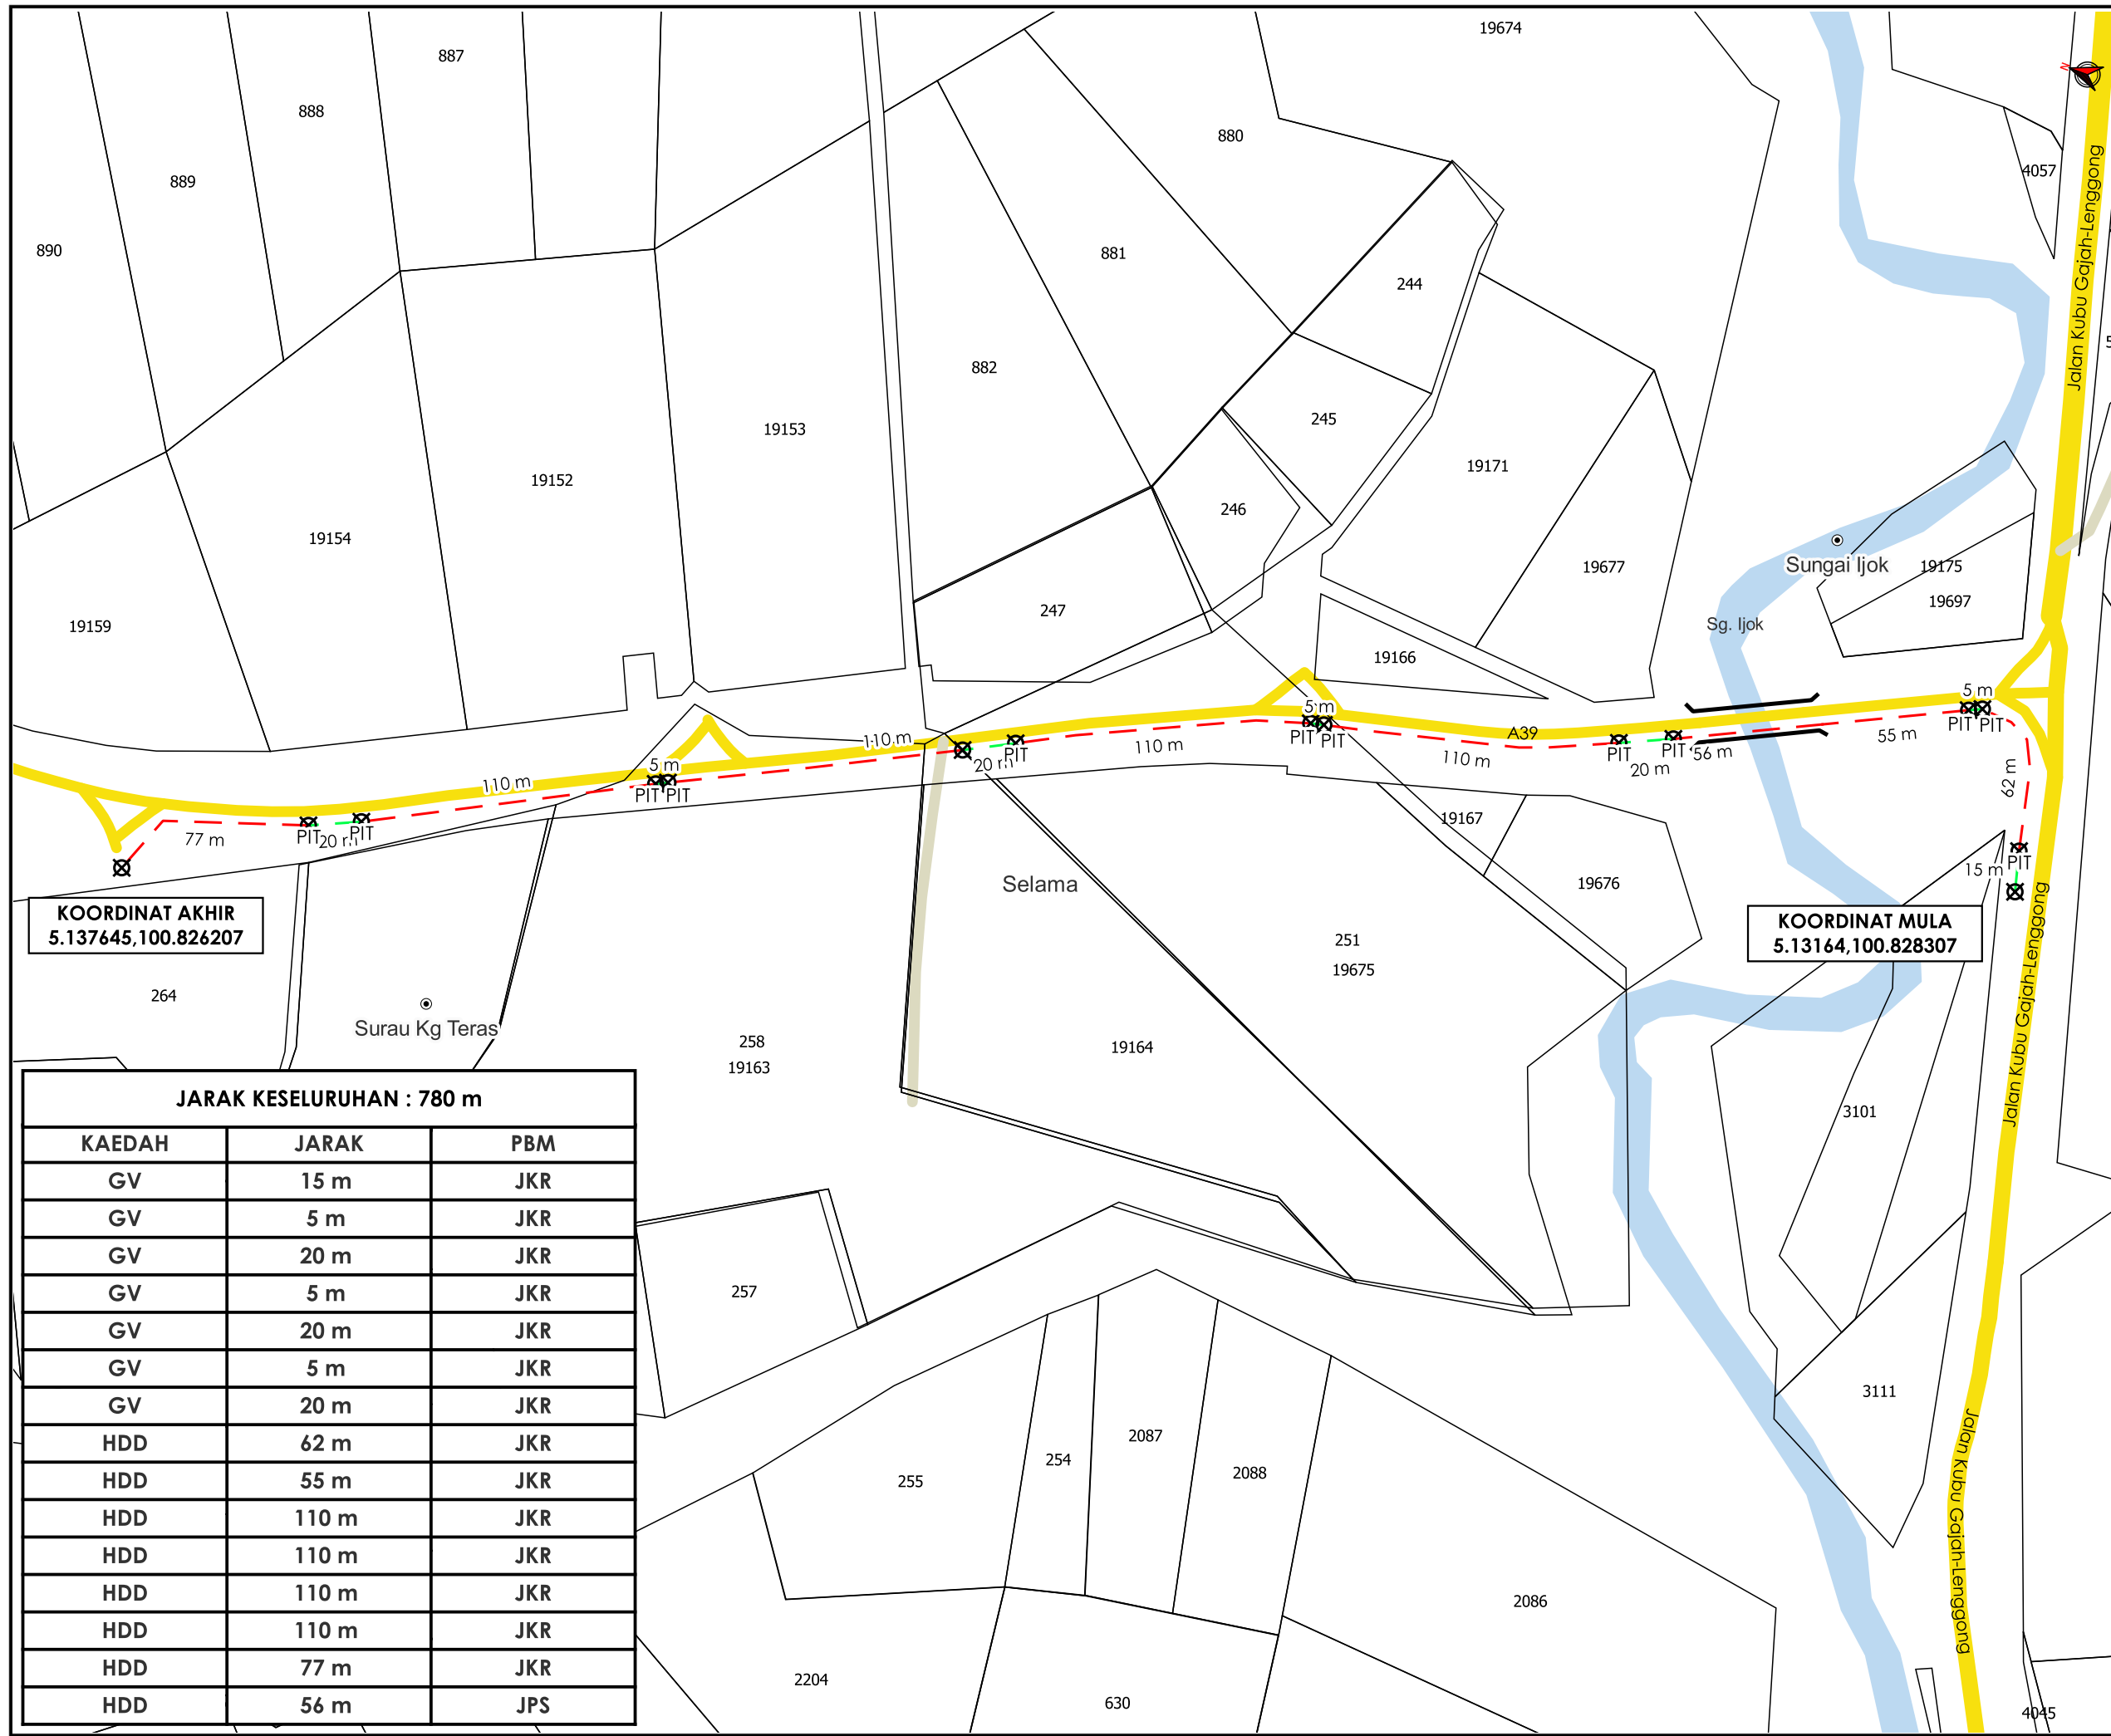

KOORDINAT AKHIR
 5.137645, 100.826207

KOORDINAT MULA
 5.13164, 100.828307

JARAK KESELURUHAN : 780 m

KAEDAH	JARAK	PBM
GV	15 m	JKR
GV	5 m	JKR
GV	20 m	JKR
GV	5 m	JKR
GV	20 m	JKR
GV	5 m	JKR
GV	20 m	JKR
HDD	62 m	JKR
HDD	55 m	JKR
HDD	110 m	JKR
HDD	110 m	JKR
HDD	110 m	JKR
HDD	110 m	JKR
HDD	77 m	JKR
HDD	56 m	JPS

***PENGUKURAN BERDASARKAN JARAK SATELIT**