

**KORIDOR
UTILITI**
DARUL RIDZUAN




**TENAGA
NASIONAL**

**MSVT (DTPGS254551) MENUKAR KABEL TALIAN ATAS VOLTAN TINGGI
11KV ABC BERSAIZ 70MMP KEPADA KABEL BAWAH TANAH XLPE 3C
240MMP DARI SS KG. TERAS KE PE KG. TERAS, TAIPING SEPANJANG
2100M**

**PELAN IZIN LALU
(PINDAAN 01)**

**NO FAIL RUJUKAN
KUDR/TNBS/A/06/25/0619**

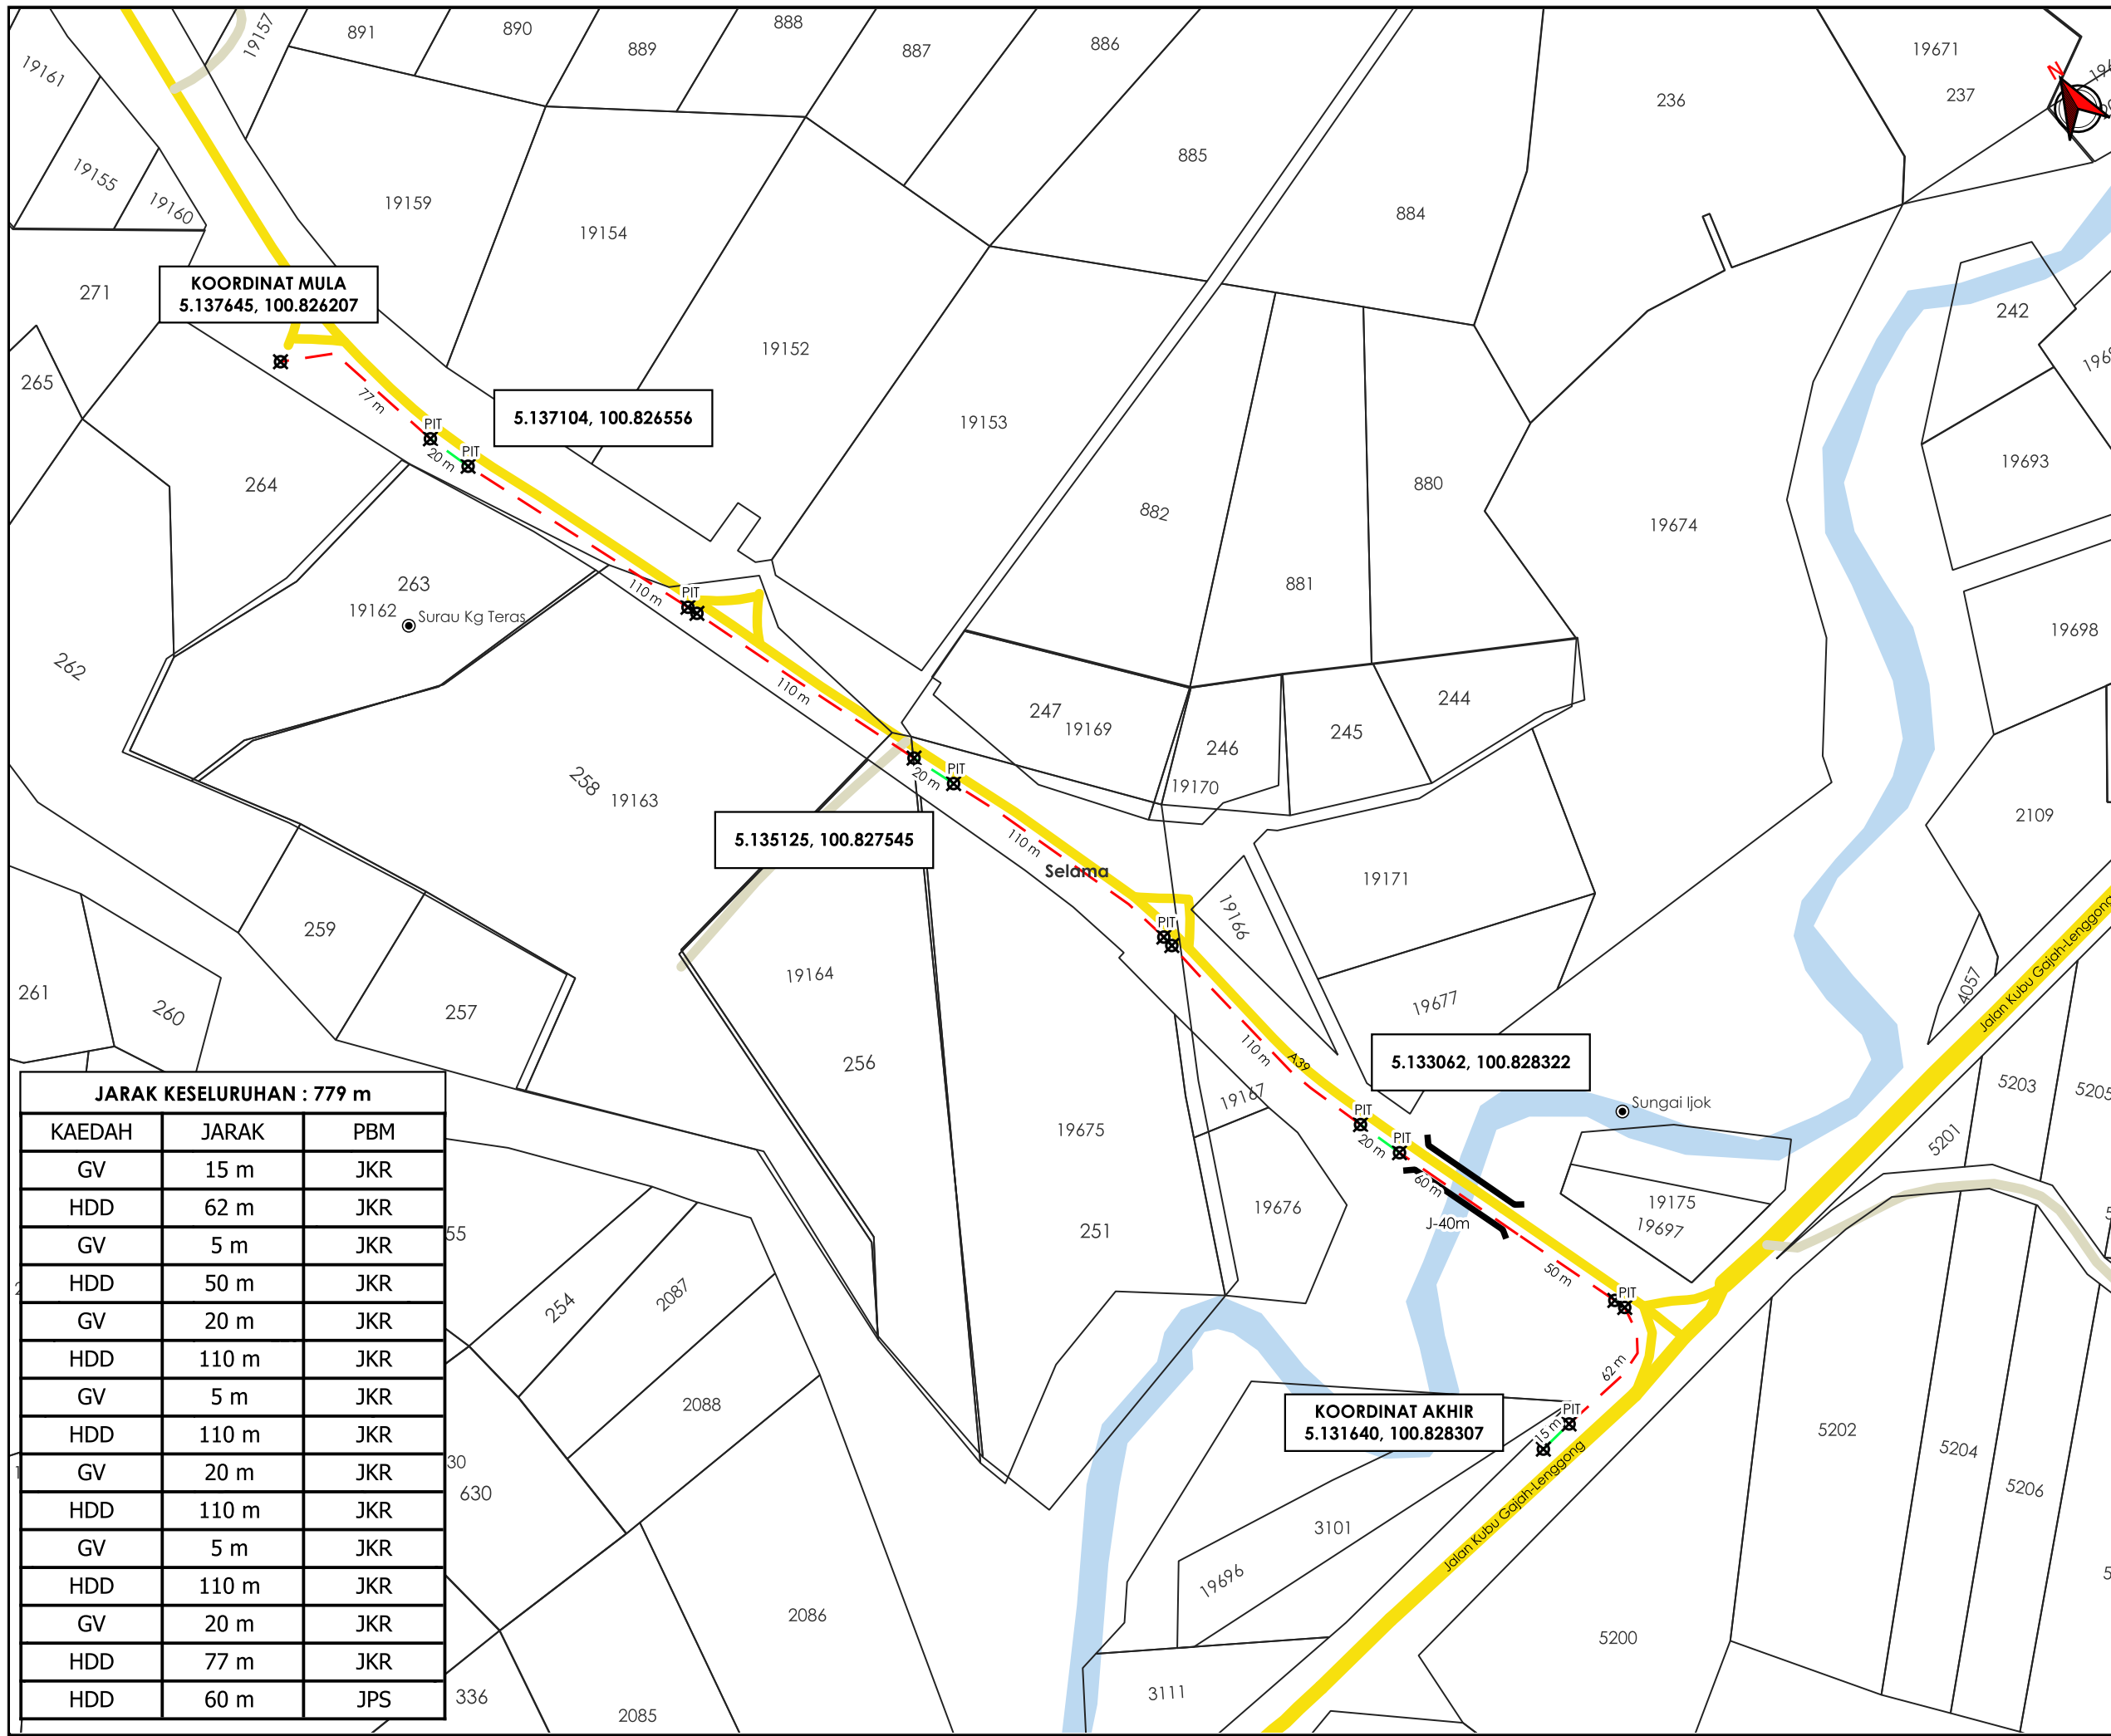

KOORDINAT MULA
5.137645, 100.826207

5.137104, 100.826556

5.135125, 100.827545

5.133062, 100.828322

KOORDINAT AKHIR
5.131640, 100.828307

JARAK KESELURUHAN : 779 m

KAEDAH	JARAK	PBM
GV	15 m	JKR
HDD	62 m	JKR
GV	5 m	JKR
HDD	50 m	JKR
GV	20 m	JKR
HDD	110 m	JKR
GV	5 m	JKR
HDD	110 m	JKR
GV	20 m	JKR
HDD	110 m	JKR
GV	5 m	JKR
HDD	110 m	JKR
GV	20 m	JKR
HDD	77 m	JKR
HDD	60 m	JPS



TAJUK PERMOHONAN
MSVT (DTPGS254551) MENUKAR KABEL TALIAN ATAS VOLTAN TINGGI 11KV ABC BERSAIZ 70MMP KEPADA KABEL BAWAH TANAH XLPE 3C 240MMP DARI SS KG. TERAS KE PE KG. TERAS, TAIPING SEPANJANG 2100M

- PETUNJUK**
- JALAN JKR
 - JALAN PERSENDIRIAN
 - JAMBATAN
 - GRASS VERGE
 - - - HORIZONTAL DIRECTIONAL DRILLING
 - X TITIK MULA AKHIR

PIHAK BERKUASA MELULUS

	JKR LARUT MATANG & SELAMA
	JABATAN PENGAIRAN DAN SALIRAN SELAMA

PENYEDIA UTILITI

JENIS PELAN	PELAN IZIN LALU
PELUKIS PELAN	ADIB FARHAN
TARIKH DIKELUARKAN	2025-09-25
MUKA SURAT	1/1
NO FAIL RUJUKAN	PINDAAN
KUDR/TNBS/A/06/25/0619	01

***PENGUKURAN BERDASARKAN JARAK SATELIT**