

**KORIDOR
UTILITI**
DARUL RIDZUAN





**TENAGA
NASIONAL**

**MSVT CADANGAN MEWUJUDKAN PE BARU BAGI MENGATASI
MASALAH LOW VOLTAGE DI KG. CHUAR HULU, KUALA KANGSAR**

**PELAN IZIN LALU
(PINDAAN 01)**

**NO FAIL RUJUKAN
KUDR/TNBS/B/02/26/0077**

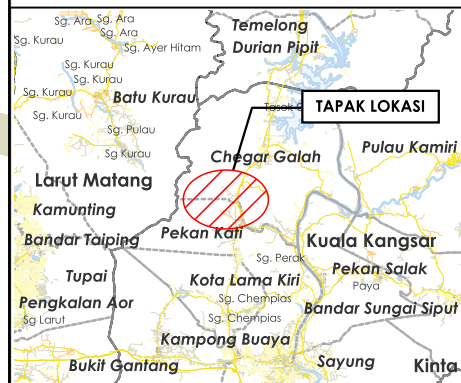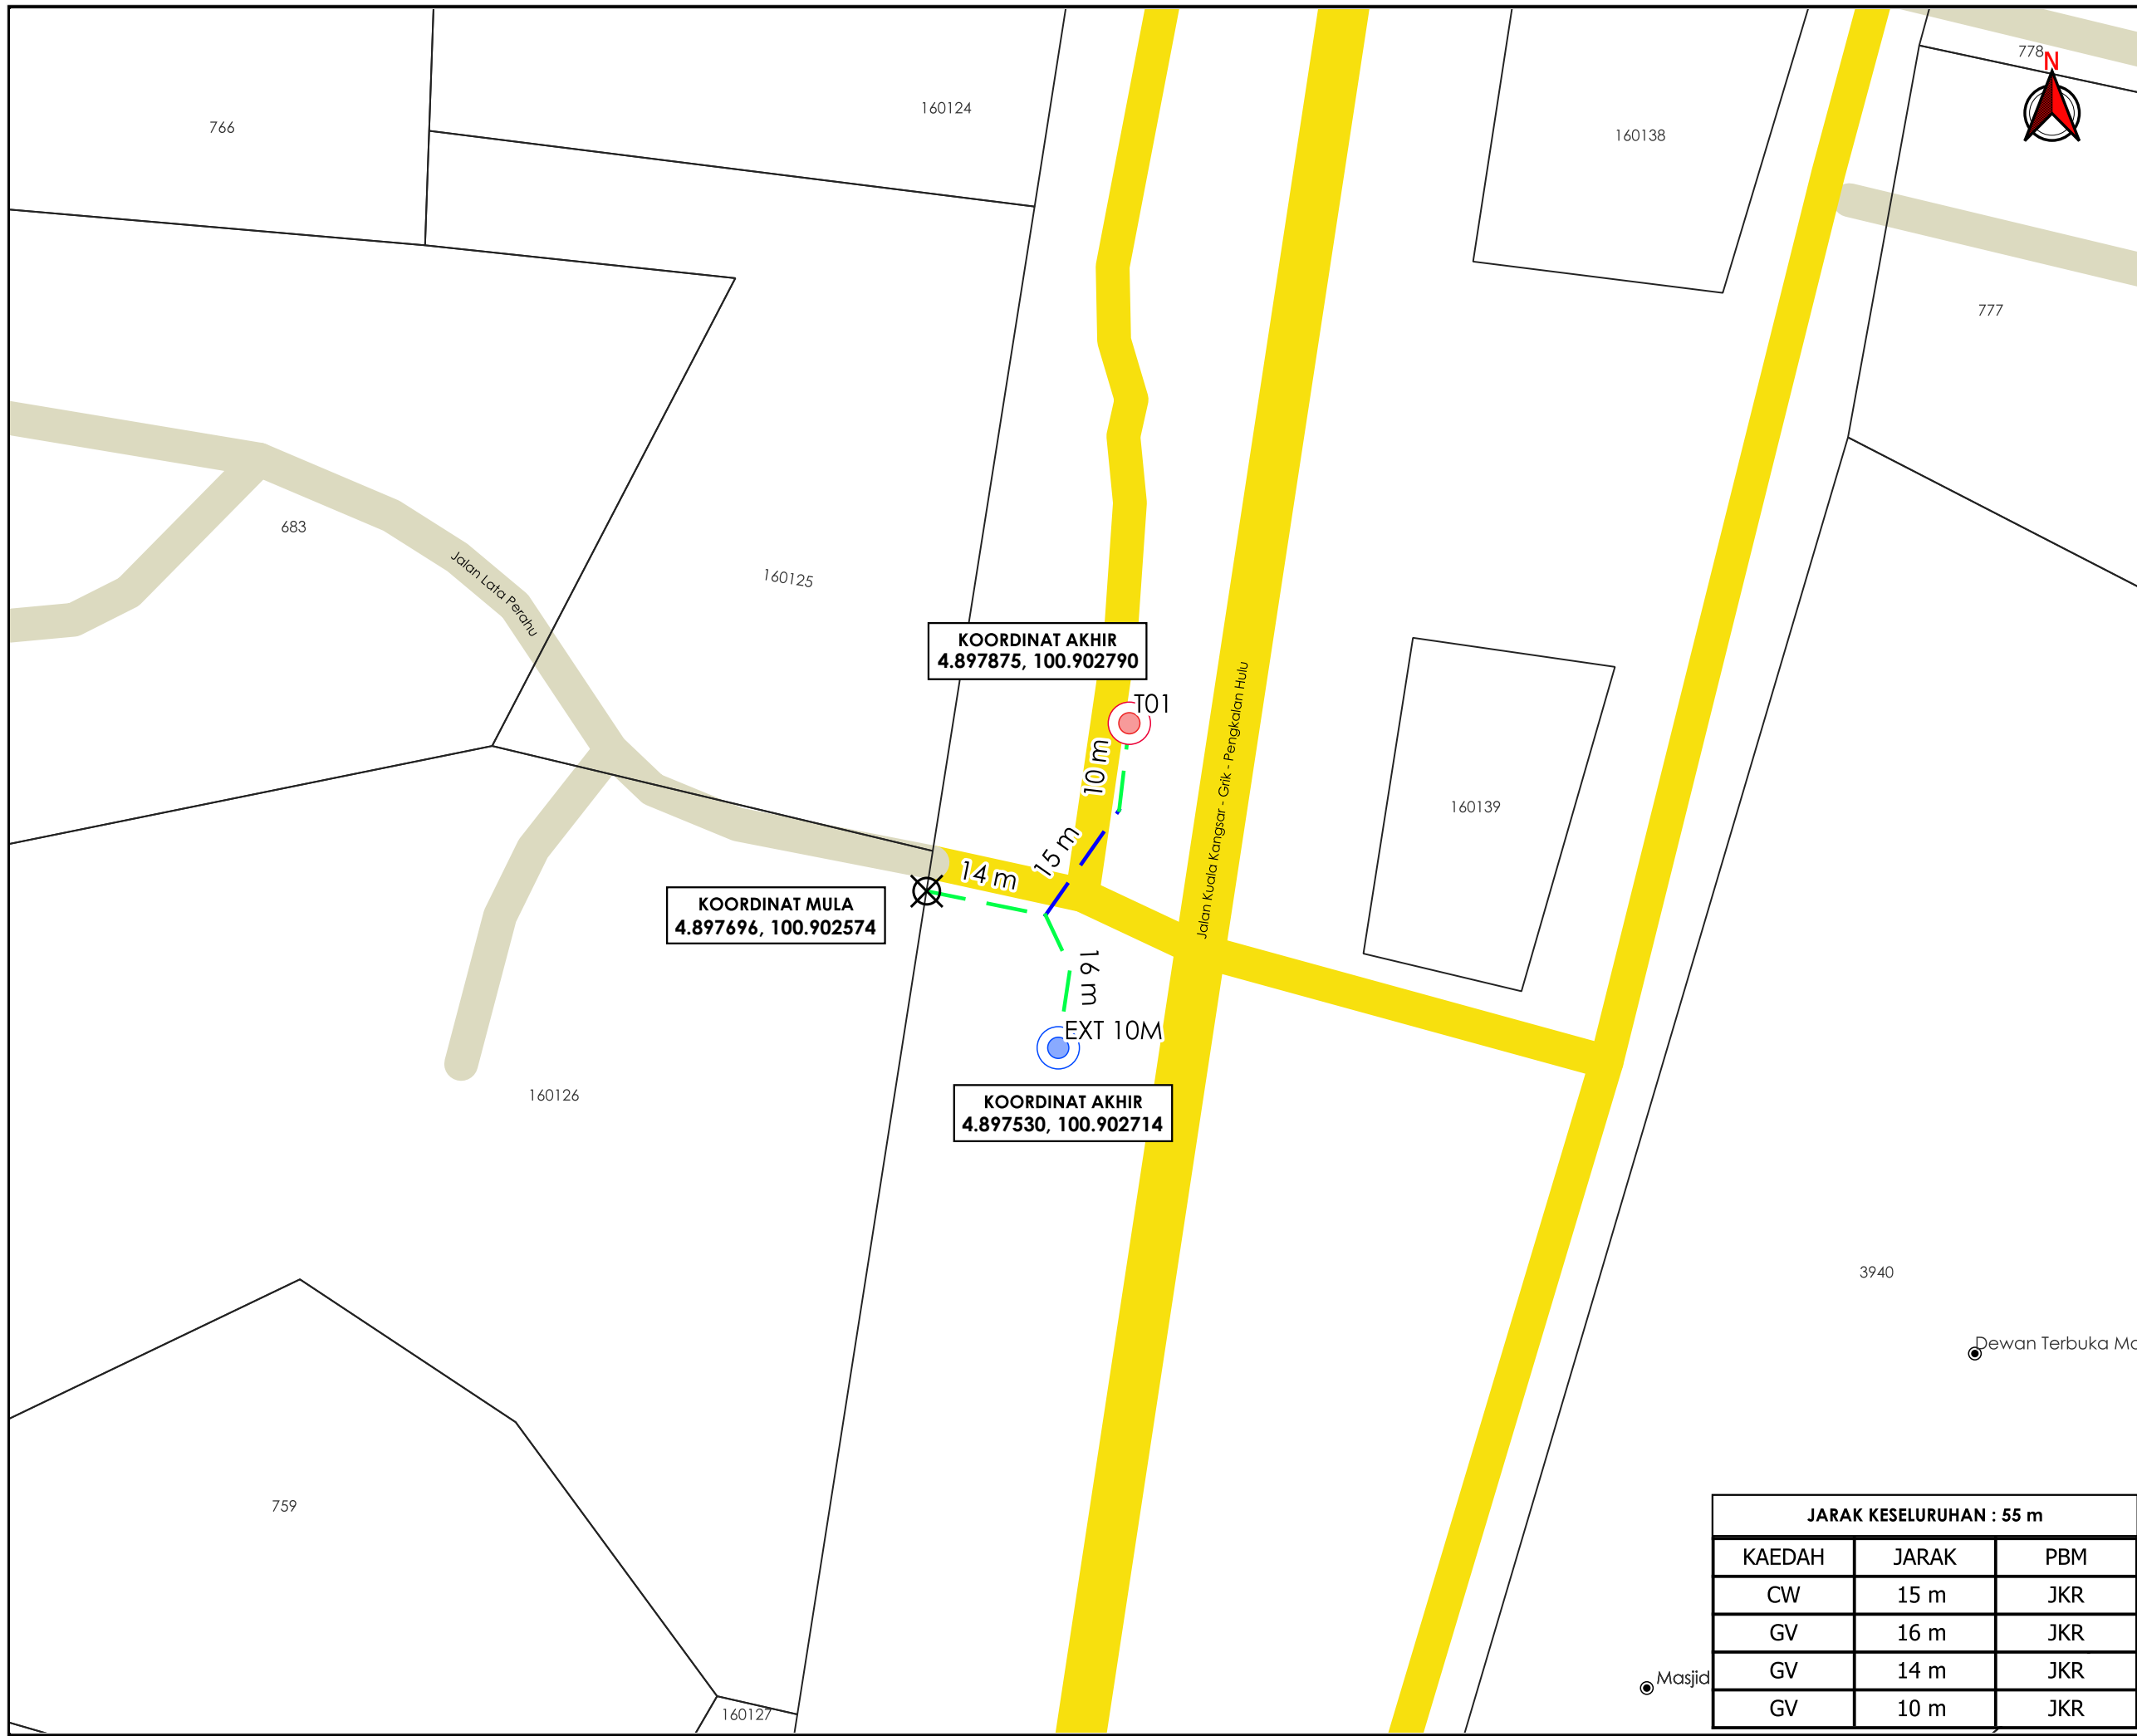

TAJUK PERMOHONAN
 MSVT CADANGAN MEWUJUDKAN PE BARU BAGI
 MENGATASI MASALAH LOW VOLTAGE DI KG. CHUAR
 HULU, KUALA KANGSAR

- PETUNJUK**
- JALAN JKR
 - JALAN PERSENDIRIAN
 - CARRIAGE WAY
 - GRASS VERGE
 - TIANG CADANGAN
 - TIANG SEDIA ADA
 - TITIK MULA AKHIR

PIHAK BERKUASA MELULUS
JABATAN KERJA RAYA KUALA KANGSAR

PENYEDIA UTILITI

JARAK KESELURUHAN : 55 m		
KAEDAH	JARAK	PBM
CW	15 m	JKR
GV	16 m	JKR
GV	14 m	JKR
GV	10 m	JKR

JENIS PELAN	PELAN IZIN LALU
PELUKIS PELAN	ADIB FARHAN
TARIKH DIKELUARKAN	2026-02-27
MUKA SURAT	1/1
NO FAIL RUJUKAN	PINDAAN
KUDR/TNBS/B/02/26/0077	01

***PENGUKURAN BERDASARKAN JARAK SATELIT**